


NOTE:

THICKNESS OF CONCRETE PATCH SHALL BE AS SPECIFIED IN SCDOT PERMIT REQUIREMENTS. MINIMUM 6" OF 3500 PSI CONCRETE AND 4" SABC COMPACTED BASE AS PER PERMIT REQUIREMENTS

NOTE:

THICKNESS OF ASPHALT PATCH SHALL BE AS SPECIFIED IN SCDOT PERMIT REQUIREMENTS. MINIMUM 1 1/2" COMPACTED ASPHALT

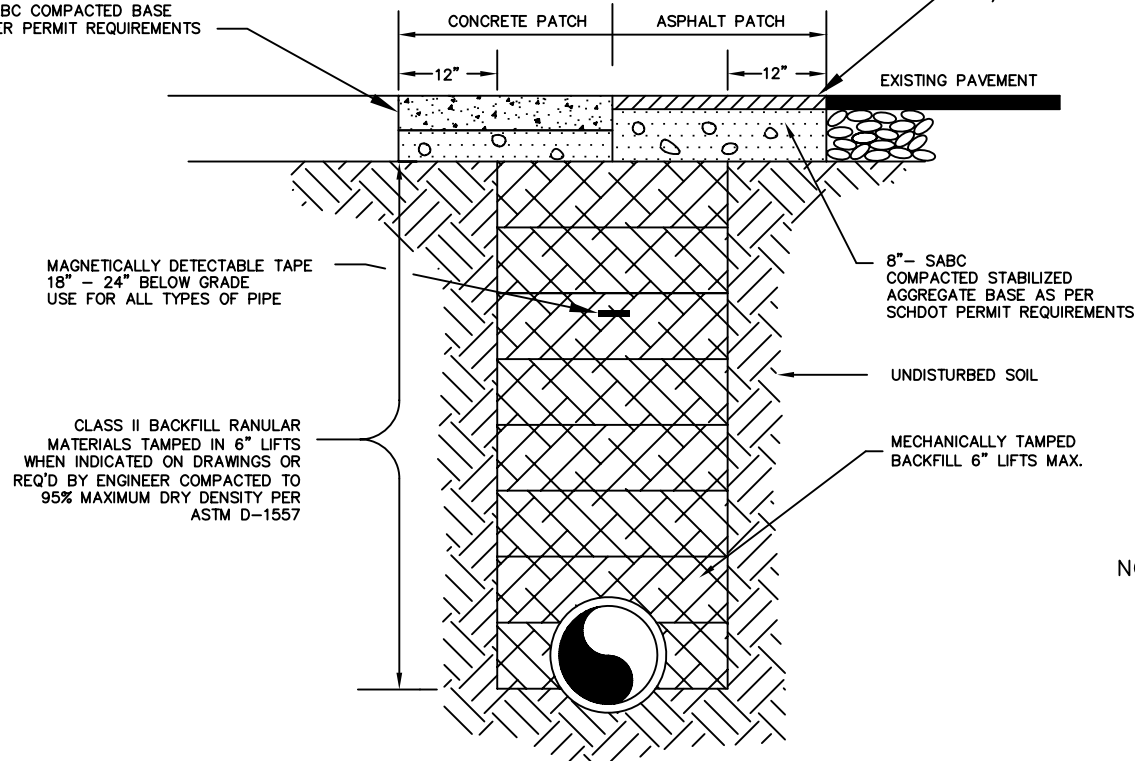

NOTE: REFER TO HIGHWAY DEPARTMENT, CITY, OR COUNTY PERMIT FOR ADDITIONAL REQUIREMENTS.

MAIN UNDER PAVED DRIVEWAY

CHARLESTON WATER SYSTEM

MAIN UNDER PAVED DRIVEWAY

APPROVED BY: CWS	DATE: MAR 2000	DRAWING NO. 3
SCALE: NTS	REVISED: FEB 2010	