
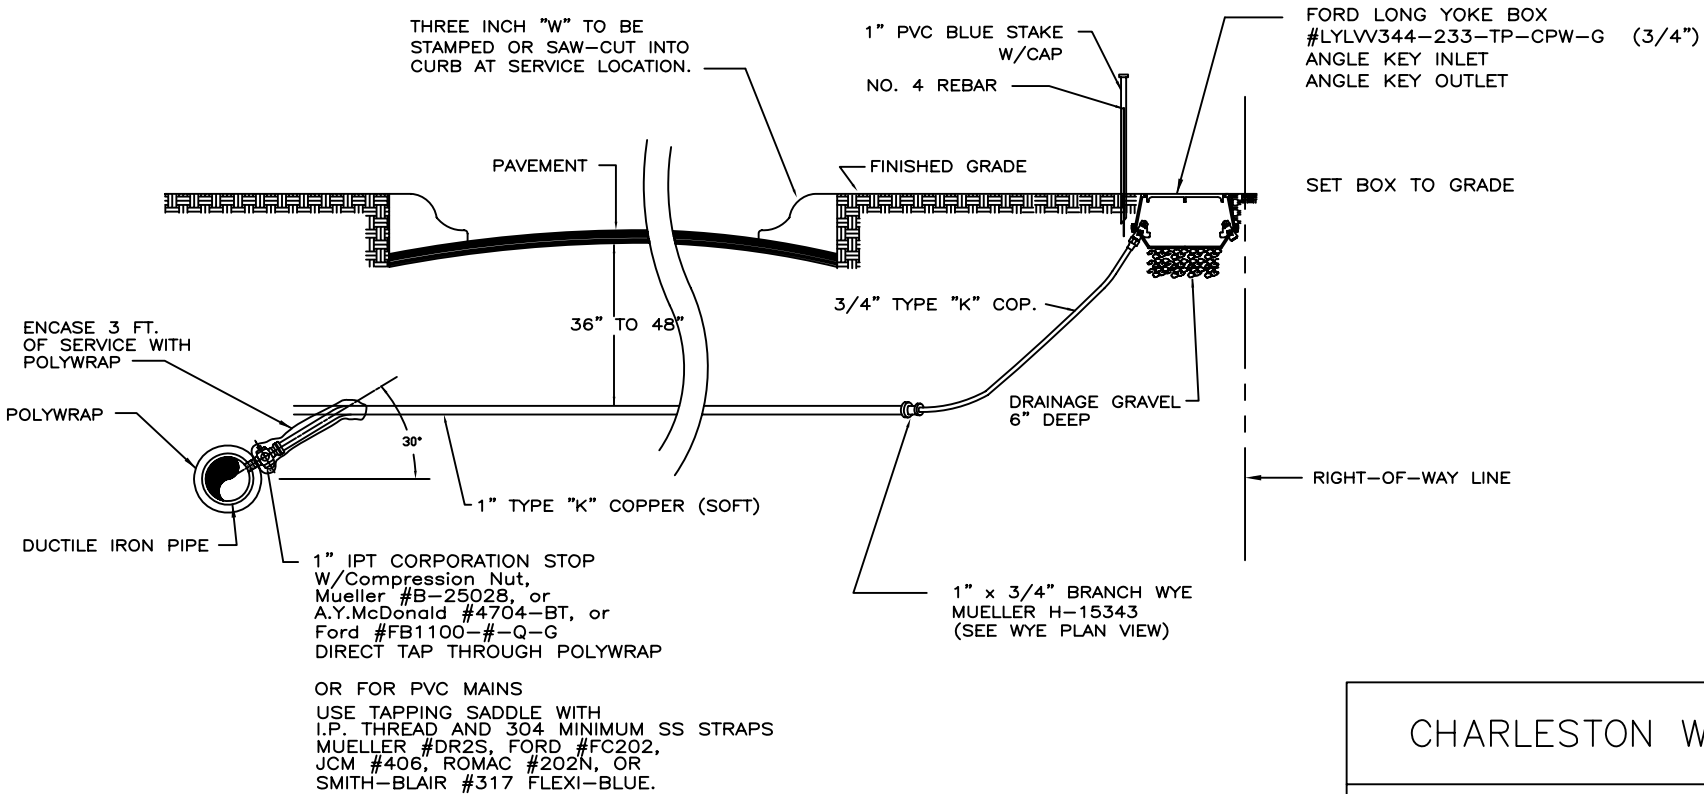


- NOTES:**
1. Contractor will provide all material and install services under CPW supervision and developer's engineering inspector.
 2. All taps will be made in accordance with CPW specifications and AWWA guidelines for tapping through polyethylene encasement
 3. All meter boxes shall be installed perpendicularly to the property line, as shown herein.

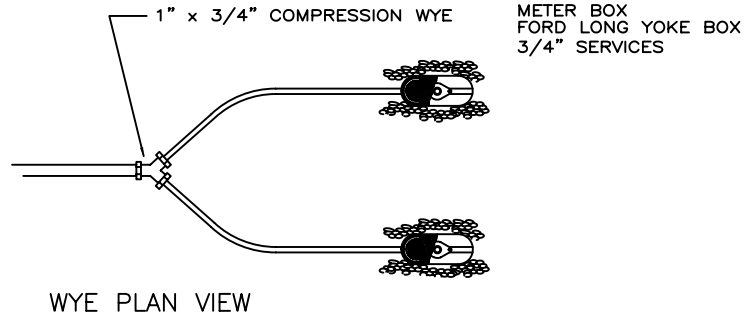

TYPICAL DOUBLE WATER SERVICE
(ONLY FOR APARTMENTS, CONDOMINIUMS, AND TRAILER PARKS)

CHARLESTON WATER SYSTEM		
TYPICAL DOUBLE WATER SERVICE		
APPROVED BY: CWS	DATE: DEC 2002	DRAWING NO. 22
SCALE: NTS	REVISED: FEB 2010	