


- NOTES:
1. METER BOXES SHALL TYPICALLY BE SET PERPENDICULARLY TO THE RIGHT-OF-WAY LINE.
 2. METER BOXES SHALL BE INSTALLED OUTSIDE OF ANY PAVED SURFACE.
 3. EXCEPTIONS TO NOTES 1 AND 2 MUST HAVE WRITTEN APPROVAL FROM THE WATER DISTRIBUTION DEPARTMENT.
 4. STAMP OR CUT A "W" IN THE CURB AND GUTTER NEARER THE WATER METER,
 5. STAMP OR CUT AN "X" IN THE CURB AND GUTTER NEARER THE SEWER CLEANOUT,
 6. FOR ADDITIONAL INFORMATION CONCERNING SERVICE LOCATIONS, REFER TO THE SERVICE DETAILS.

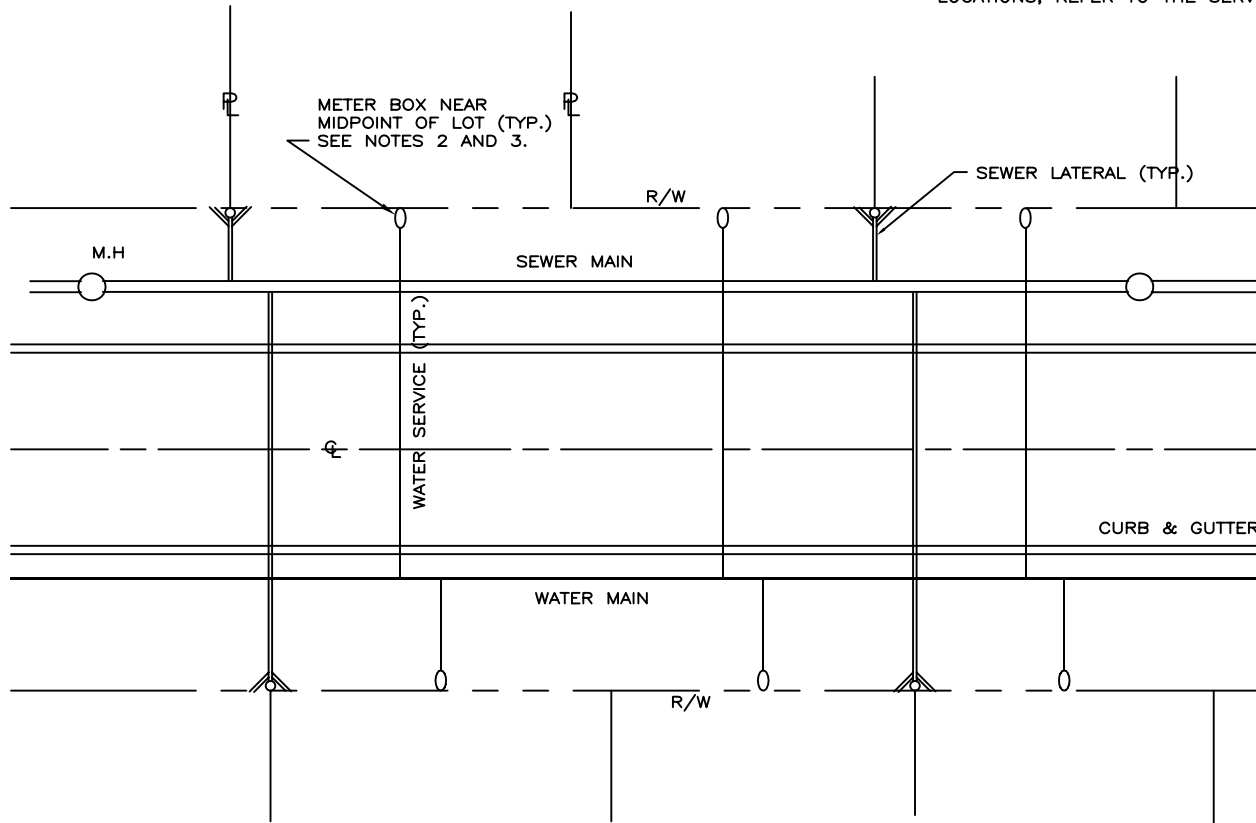

TYPICAL SERVICE LOCATION

CHARLESTON WATER SYSTEM

TYPICAL SERVICE LOCATION

APPROVED BY: CWS	DATE: MAR 2000	DRAWING NO. 23
SCALE: NTS	REVISED: FEB 2010	